



MTS Metallurgical Testing Services
ABN 54 122 133 331
3/52 Cocos Drive Bibra Lake Western Australia 6163
Tel 08 9418 6380 Fax 08 9434 1328

Test Report

To Sorrento Glass
1 / 7 Hector St Osborne Park WA 6017
Order No. G. Vile

Report No. **MTS-18449 SG**
Issue Date 25/07/2014
Test Date 13/06/2014

Introduction

MTS Metallurgical Testing Services was engaged to perform load tests on a toughened glass pool fence panel in general accordance with the requirements of AS 1926.1 - 2012.

Details

ID	Item/Heat No.	Dimensions/Type/Details	Finish	Overall Assessment
18449/01	Frameless Glass	1.0m Long x 1.2m High with 40mm Round Duplex stainless steel spigots	Polished	COMPLIES

Examinations & Tests

A visit was made to the test site to verify the installation arrangements against supplied drawings. A subsequent visit was made once the grout had cured to conduct a load test.

Summary

The results of the tests herein COMPLIED with the requirements of the stated standard/s and/or specification/s.

Colin Lorrimar
Metallurgical Testing Manager

Results

Core-drilled spigots




40mm Round spigot face view



40mm Round spigot side view

Visual Examination

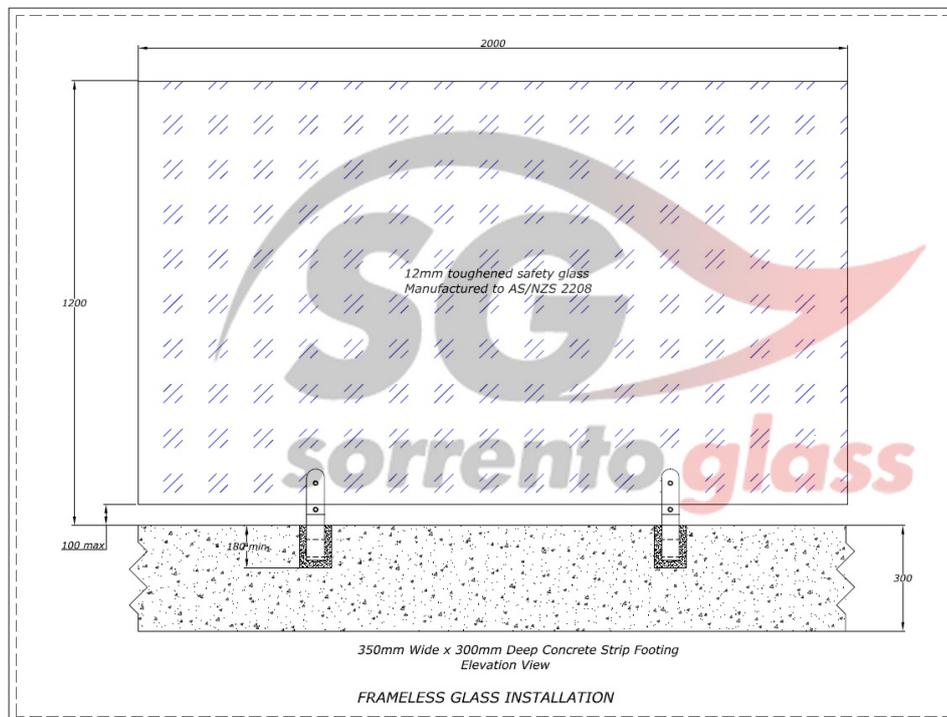

The panel was installed in accordance with the details of this drawing, modified to suit the 100mm thick floor at the test site.

Results

Load Test

Test Specification AS 1926.1 - 2012, Appendix C **Test Procedure** MTS-TP3.7 Load Tests of Protective Enclosures, Barriers and Fences

Specimen ID	Test Load (N)	Deflection Under Load (mm)	Permanent Distortion (mm)	Observations	Assessment
18449/01	330	24.0	1.5	No damage, loosening or permanent distortion.	COMPLIES



The pool fence panel under test load showing the hydraulic ram and digital load indicator.

Requirements No breakage or signs of fracture or loosening of any part. Maximum Permanent Distortion: 6mm.